

Corporate Office
9360 Holy Cross Lane
Breeze, IL 62230
(P) 618.526.9611
(F) 866.666.7213

Murphysboro Office
1032 N. 6th Street
Murphysboro, IL 62966
(P) 618.684.9355
(F) 618.565.1079

Metropolis Office
605 Market Street
Metropolis, IL 62960
(P) 618.524.1085
(F) 618.524.3902

Troy Office
409 Edwardsville Road
Suite A
Troy, IL 62294
(P) 618.667.5940
(F) 618.667.5946

CIVIL
ENVIRONMENTAL
STRUCTURAL
SURVEYING/GIS
TRANSPORTATION
WASTEWATER
WATER SUPPLY


www.hmgengineers.com

DATE: September 30, 2020
TO: All Plan Holders
FROM: HMG Engineers, Inc.
SUBJECT: Addendum No. 1
Lift Station #14 Forcemain Replacement

Attached please find Addendum No. 1 dated September 30, 2020, to the plans and specifications for the subject project and ask that you take same into consideration in submitting your proposal.

BIDDERS SHALL NOTE IN WRITING ON THE PROPOSAL FORM THAT ADDENDUM NO. 1 HAS BEEN TAKEN INTO CONSIDERATION. FAILURE TO DO SO WILL BE SUFFICIENT CAUSE TO REJECT THE BID.

Bids are due at the Mt. Vernon City Hall, 1100 Main Street, Mt. Vernon, Illinois at **10:00 A.M. prevailing time on Tuesday, October 27, 2020.**

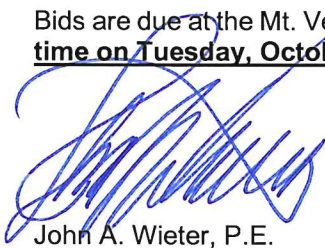

John A. Wieter, P.E.

Attachment: Addendum No. 1 dated September 30, 2020, 1 page plus attachment.

Subsidiaries & Affiliates

HMG Constructors, LLC
Design-Build Services

HMG Infrastructure Services, LLC
Utility Operations

RHMG Engineers, Inc.
Mundelein, IL
Civil
Water/Wastewater
Surveying/GIS

Asaturian Eaton & Associates, Inc.
Carbondale, IL
Civil
M/E/P
Surveying

Addendum No. 1
Issued September 30, 2020
Lift Station #14 Forcemain Replacement
for the
City of Mt. Vernon, Illinois

NOTE: Wherein this Addendum conflicts with the original contract documents dated SEPTEMBER 2020, this Addendum shall govern.

SPECIFICATIONS

The following specifications have been revised:

1. Specification Section 15129 AIR RELEASE VALVES PART 2 PARAGRAPH 2.01 B ,C, D, & E shall read:
 - B. Materials:
 1. Body: 316 Stainless Steel ASTM A240.
 2. Cover: 316Stainless Steel ASTM A240.
 3. Internal Linkage: Stainless Steel ASTM A240.
 4. Float: Stainless Steel ASTM A240
 5. No Bronze or Galvanized Parts.
 - C. Manufacturers: Sewage Air Relief Valves shall be APCO Valve Corporation Model ASU or equal.
 - D. Sizing: Size per manufacturer's recommendations.
 - E. Accessories: All appurtenances required for complete installation. Sizing of all accessory valves shall be in accordance with manufacturer's recommendations.

END OF ADDENDUM NO. 1